

Characterization of the Airtightness Level in School Classrooms in Mediterranean Climate

Miguel A. Campano, Jesica Fernández-Agüera, Samuel Domínguez-Amarillo, Juan J. Sendra

Abstract—An analysis of the air tightness level is performed on a representative sample of school classrooms in Southern Spain, which allows knowing the infiltration level of these classrooms, mainly through its envelope, which can affect both energy demand and occupant's thermal comfort.

By using a pressurization/depressurization equipment (Blower-Door test), a characterization of 45 multipurpose classrooms have been performed in nine non-university educational institutions of the main climate zones of Southern Spain. In spite of having two doors and a high ratio between glass surface and outer surface, it is possible to see in these classrooms that there is an adequate level of airtightness, since all the n50 values obtained are lower than 9.0 ACH, with an average value around 7.0 ACH.

Keywords—Air infiltration, energy efficiency, school buildings, thermal comfort, indoor air quality, ventilation.

I. INTRODUCTION

WHEN the environmental performance of the architectonic enclosures is analysed, the ventilation appears as one of the main variables that affect the energy demand, the degree of environmental comfort [1], [2] and rate accumulation of CO₂, suspended particles and pollutants [3]. In non-residential buildings, European ventilation standards [4] establish the need to guarantee a minimum outdoor airflow for an adequate IAQ control. Thus, it is necessary to resort to mechanical ventilation with stages of filtration. However, in Mediterranean climates, ventilation is usually relied both on uncontrolled infiltrations through the envelope and windows opening, except the most modern buildings.

An enclosure pressurization/depressurization equipment or Blower Door, widely recognized by the scientific community [5], [6], can quantify the infiltrations in this type of educational facilities. By its use, it is possible to perform a series of in situ pressurization/depressurization tests in a room, in order to determine the airtightness level of its envelope. This also allows assessing its associated impact on the inner thermal comfort level, due to uncontrolled air inlets with inadequate conditions of temperature [7].

The methodology presented in this airtightness study has been applied in non-university classrooms of Southern Spain.

M. A. Campano, S. Domínguez-Amarillo and J. J. Sendra are with the Instituto Universitario de Arquitectura y Ciencias de la Construcción of the Universidad de Sevilla, Sevilla 41007 Spain (phone: +34954559517, +34954559517, +34954556595, fax: +34954557024; e-mail: mcampano@us.es, sdomin@us.es, jsendra@us.es).

J. Fernández-Agüera is with the Instituto de Ciencias de la Construcción Eduardo Torroja of the Consejo Superior de Investigaciones Científicas, Madrid 28033 Spain (phone: +34913020440; fax: +34913020700; e-mail: jfernandezaguera@us.es).

Educational facilities represent a geographically widespread typology, having a high constant use by highly sensitive occupants and being usually ventilated by uncontrolled infiltrations and windows opening [8], so the envelope permeability becomes a high relevant factor for their final indoor environmental quality [9]–[12].

TABLE I
EDUCATIONAL INSTITUTIONS PER CLIMATE ZONE

| Climate zone | | Location | | Educational institution (EI) | Classrooms under study |
|--------------|--------|----------|--------------|------------------------------|------------------------|
| TBC* | Koppen | Province | Municipality | | |
| A4 | BSk | Almería | Almería | EI 1 | 4 |
| | BSk | Almería | Almería | EI 2 | 4 |
| | Csa | Huelva | Aljaraque | EI 3 | 3 |
| B4 | Csa | Seville | Dos Hermanas | EI 4 | 6 |
| | Csa | Seville | Dos Hermanas | EI 5 | 3 |
| | Csa | Granada | Churriana | EI 6 | 10 |
| C3 | Csa | Granada | Cullar Vega | EI 7 | 4 |
| | Csa | Granada | Guadix | EI 8 | 5 |
| C4 | Csa | Jaén | Jaén | EI 9 | 6 |
| TOTAL | | | | | 45 |

*Spanish Technical Building Code [13].

II. SCHOOL CLASSROOMS CASE STUDY

For this work, it has been selected 45 multipurpose classrooms of nine primary and secondary educational institutions, which are located in Southern Spain (Table I). All of them are exempt building, with a lineal or comb-shaped distribution.

The multipurpose classroom typology under study, designed under the regional no-university educational institutions standard [14], accommodate up to 30 students with their teacher. Dimensions are about 50 square metres and at least 3.00 metres high, with the window to the left. Rooms are usually defined by horizontal and vertical partitions in contact with other classrooms of similar size and use, and the common access corridor, with which normally communicates through two doors (Fig. 1).

There is no false ceiling in any of the measured classrooms, as well as perforations in the inner partitions with adjacent classrooms.

The external vertical wall is usually performed by a half-brick wall (with or without rendering), air chamber, thermal insulation (projected polyurethane) and a simple hollow brick wall with setting plaster. The inner partitions are in general composed by a half-brick wall with setting plaster on both sides.

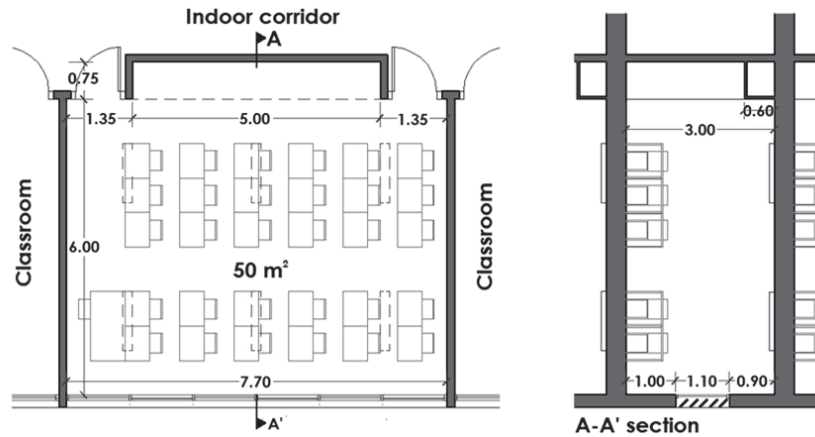


Fig. 1 Multipurpose classroom according to design standards for regional educational institutions

III. METHODOLOGY

The assessment of the infiltration level of the classrooms under study was performed by a series of airtightness tests (doors and windows closed); in order to obtain their expected average infiltrations rates (Fig. 2). These tests consist of decreasing the room pressure by using a fan, which extracts air till the indoor-outdoor differential pressure is stabilized. It is achieved by balancing the extracted airflow with the entering airflow through the envelope cracks. Then, the depressurization is decreased in steps by lowering the fan speed, in order to obtain the regression curve of the pressure/extracted airflow relation, which shows the entering airflow when the indoor pressure is equals to the atmospheric one. These tests were performed by using an enclosure pressurization-depressurization equipment or "Blower door", as specified in the ISO standard 9972: 2015 [6], considering each classroom as a single zone to be analyzed. The specific model used is the *Minneapolis Blower Door Model 4/230 V System*, which is controlled by the *TECTITE Express* software.

The higher-pressure difference used to create this regression curve must be at least ± 50 Pa; in this study, it has been reached until a ± 70 Pa differential pressures.

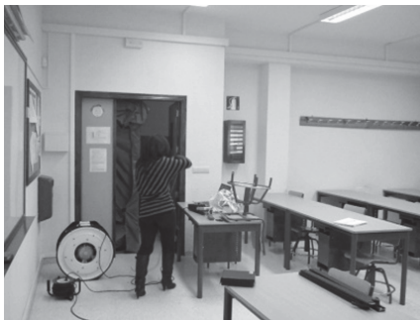


Fig. 2 Airtightness measurement of a classroom

When the classroom has a single access point, the pressurization-depressurization test characterizes the airflow that can pass through the envelope by sealing the corresponding door. However, in most of the studied

classrooms there are two access points, so it is necessary to perform three measurements in each classroom, changing the location of the blower door and sealing, or not, the door in which the blower door is disposed. In this way, it is possible to determine the real airflow that enters into the classroom during its normal operation (Fig. 3):

- Measurement 1 (m1): The equipment is installed in the door B. Door A is not sealed (free air pass through its gaps).
- Measurement 2 (m2): The equipment is installed in the door A. Door B is not sealed (free air pass through its gaps)
- Measurement 3 (m3): The equipment is installed in the door A. Door B sealed.

Infiltrations values measured in each of these three ± 50 Pa depressurization test hypotheses, developed in each classroom, are obtained by the following expressions of the British Standard 5925 standard (1)-(4), obtained from a simplification of the "crack flow equation" [15]:

$$n_{50,1} = (V_{50,Da} + V_{50,e})/V \quad (1)$$

$$n_{50,2} = (V_{50,Db} + V_{50,e})/V \quad (2)$$

$$n_{50,3} = V_{50,Dc} / V \quad (3)$$

$$n_{50} = (V_{50,Da} + V_{50,Db} + V_{50,e})/V = n_{50,1} + n_{50,2} - n_{50,3} \quad (4)$$

All the equation parameters are defined in Table II.

TABLE II
UNITS FOR DEPRESSURIZATION TEST EQUATIONS

| Symbol | Quantity | Unit |
|-------------|-----------------------------------------------------------------|-----------------------|
| $V_{50,Da}$ | air leakage rate at 50 Pa which circulates through the door A | m^3/h |
| $V_{50,Db}$ | air leakage rate at 50 Pa which circulates through the door B | m^3/h |
| $V_{50,e}$ | air leakage rate at 50 Pa which circulates through the envelope | m^3/h |
| V | infiltration rate at 50 Pa for the three measurements | m^3 |
| $n_{50,1}$ | infiltration rate at 50 Pa of the measurement 1 | ACH |
| $n_{50,2}$ | infiltration rate at 50 Pa of the measurement 2 | ACH |
| $n_{50,3}$ | infiltration rate at 50 Pa of the measurement 3 | ACH |

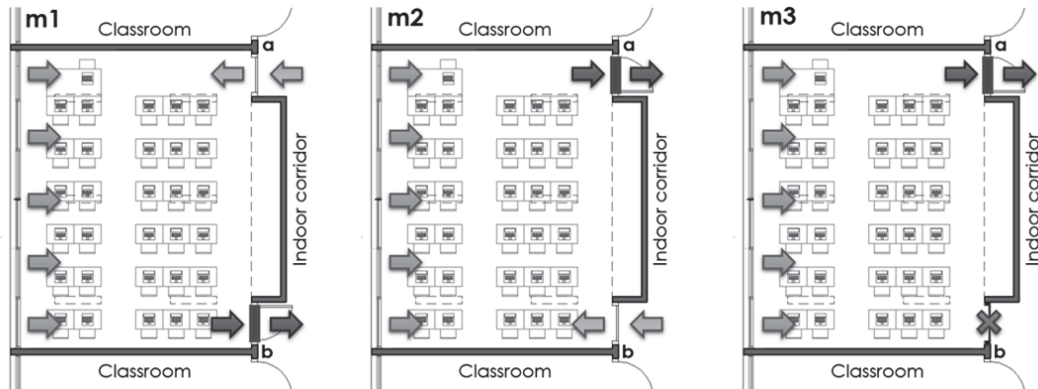


Fig. 3 Hypotheses of depressurization tests in classroom under study according to equipment location and door sealing

IV. DISCUSSION AND RESULTS

As an example of this methodology, the average results obtained from Churriana's analysed educational institution (IE 6) are presented, since its classrooms are the most representative, both for their average values and the number of measurements performed. In this way, the depressurization test graph performed in one of its classroom is shown in Fig. 4.

The obtained results of the EI 6 measurement campaign are shown in Table III, for both V_{50} and n_{50} . It is possible to see that the average infiltration rate in EI 6 measured classrooms

is 7.80 ACH for ± 50 Pa, with a standard deviation of 0.63 ACH.

TABLE III
EI 6 CLASSROOMS' AVERAGE INFILTRATION RATES

| Koppen climate zone | Classrooms under study | Air Leakage rate at 50 Pa (V_{50}) (m^3/h) | | Infiltration rate at 50 Pa (n_{50}) (ACH) | |
|---------------------|------------------------|------------------------------------------------------------------|--------------------|-----------------------------------------------|--------------------|
| | | Average | Standard deviation | Average | Standard deviation |
| Csa | 10 | 1170 | 94 | 7.80 | 0.63 |

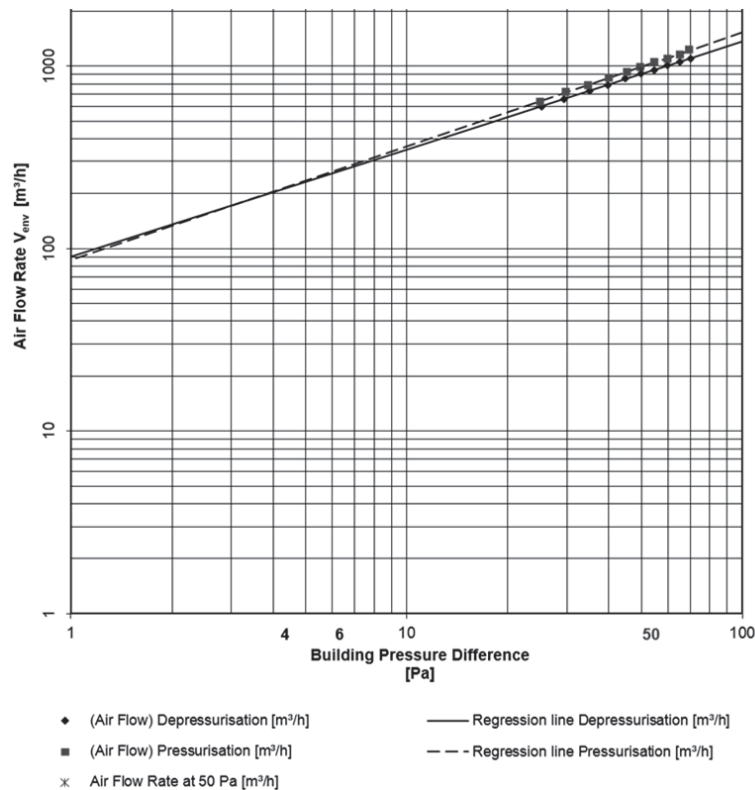


Fig. 4 Depressurization test graph of one of the EI 6 classrooms

When permeability of the all measured classrooms envelopes is analysed, it can be seen that is low. Despite having two access doors instead of one, and a glazed surface of more than 30% of the façade that contains it, n_{50} infiltration

values in all these measured classrooms is 7 ACH with a standard deviation of 1.7 ACH. Which is less than 9 ACH, the average value for multipurpose classrooms (with a single access door) according to BS 5925:1991 [15] (Fig. 5).

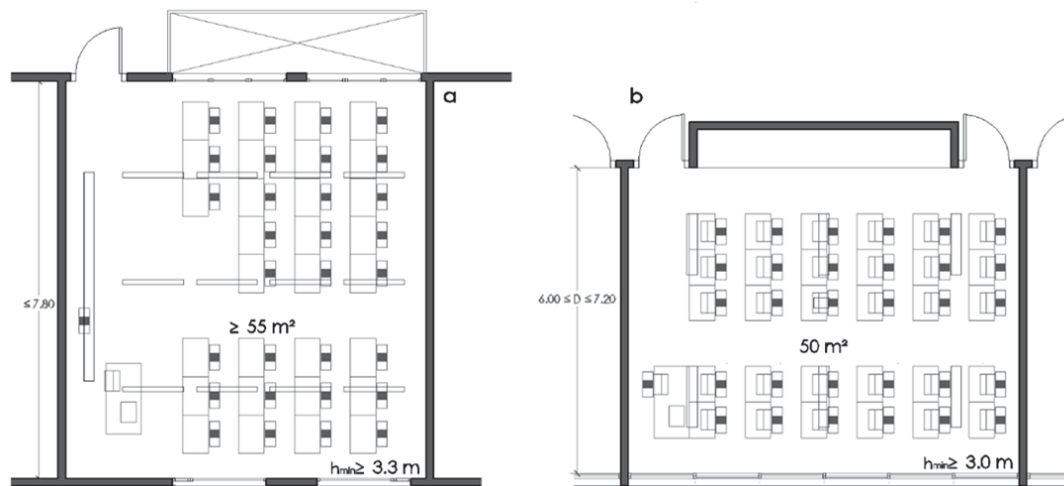


Fig. 5 Multipurpose classrooms in United Kingdom (a) and Southern Spain (b)

V. CONCLUSIONS

The envelope permeability of the non-university classrooms of Southern Spain (Mediterranean climate zone) can be considered as low. Since despite having two access doors and a glazed surface of more than 30% of the façade that contains it, the average infiltration of the measured classrooms is less than 9 ACH for ± 50 Pa (n_{50}), with an average value around 7 ACH and a standard deviation of 1.7 ACH. Further studies are required for establishing a relationship between classrooms airtightness and their environmental quality.

ACKNOWLEDGMENT

The results presented were granted public funding through Universidad de Sevilla. The authors wish to express their gratitude for all of the technical and financial support provided.

REFERENCES

- [1] ISO 7730:2005. Ergonomics of the thermal environment. Analytical determination and interpretation of thermal comfort using calculation of the PMV and PPD indices and local thermal comfort criteria. Geneva: ISO, 2005.
- [2] CR 1752:1998. Ventilation for buildings. Design criteria for the indoor environment. Luxembourg: CR, 1998.
- [3] EN 15251:2007. Indoor environmental input parameters for design and assessment of energy performance of buildings addressing indoor air quality, thermal environment, lighting and acoustics. Bruxelles: CEN, 2007.
- [4] EN 13779:2008. Ventilation for non-residential buildings. Performance requirements for ventilation and room-conditioning systems. Bruxelles: CEN, 2008.
- [5] H. E. Feustel. "Measurements of air permeability in multizone buildings," *Energy and Buildings*, vol. 14, no. 2, pp. 103-116, 1990.
- [6] ISO 9972:2015. Thermal performance of buildings - Determination of air permeability of buildings - Fan pressurization method. Geneva: ISO, 2015.
- [7] M. H. Sherman. The Use of Blower Door Data. LBL #35173. Washington: Office of Building Technology of the U.S. Department of Energy, 1998.
- [8] M. A. Campano, S. Domínguez-Amarillo and J. J. Sendra. "Analysis of thermal emissions from radiators in classrooms in Mediterranean climates," *Procedia Engineering*, vol. 21, pp. 106-113, 2011.
- [9] A. Chaloulakou and I. Mavroidis. "Comparison of indoor and outdoor concentrations of CO at a public school. Evaluation of an indoor air quality model," *Atmospheric Environment*, vol. 36, no. 11, pp. 1769-1781, 2002.
- [10] O. Poupard, P. Blondeau, V. Lordache and F. Allard. "Statistical analysis of parameters influencing the relationship between outdoor and indoor air quality in schools," *Atmospheric Environment*, vol. 39, no. 11, pp. 2071-2080, 2004.
- [11] N. Tippayawong, P. Khuntong, C. Nitatwicht, Y. Khunatorn and C. Tantakitti. "Indoor/outdoor relationships of size-resolved particle concentrations in naturally ventilated school environments," *Building and Environment*, vol. 44, no. 1, pp. 188-197, 2009.
- [12] R. M. S. F. Almeida, V. P. de Freitas. "Indoor environmental quality of classrooms in Southern European climate," *Energy and Buildings*, vol. 81, pp. 127-140, 2014.
- [13] Código Técnico de la Edificación. Madrid: Ministerio de Fomento del Gobierno de España, 2006. Accessed August 20, 2015. <http://www.codigotecnico.org>.
- [14] "Orden de 24 de enero de 2003 de la Consejería de Educación y Ciencia de la Junta de Andalucía por la que se aprueban las Normas de diseño y constructivas para los edificios de uso docente," in *Boletín Oficial de la Junta de Andalucía*, vol. 43, Ed. Sevilla: Junta de Andalucía, 2003, pp. 4669-4792.
- [15] BS 5925:1991. Code of practice for ventilation principles and designing for natural ventilation. London: BSI, 1991.