

Development of NO_x Emission Model for a Tangentially Fired Acid Incinerator

Elangeshwaran Pathmanathan, Rosdiazli Ibrahim, Vijanth Sagayan Asirvadam

Abstract—This paper aims to develop a NO_x emission model of an acid gas incinerator using Nelder-Mead least squares support vector regression (LS-SVR). Malaysia DOE is actively imposing the Clean Air Regulation to mandate the installation of analytical instrumentation known as Continuous Emission Monitoring System (CEMS) to report emission level online to DOE. As a hardware based analyzer, CEMS is expensive, maintenance intensive and often unreliable. Therefore, software predictive technique is often preferred and considered as a feasible alternative to replace the CEMS for regulatory compliance. The LS-SVR model is built based on the emissions from an acid gas incinerator that operates in a LNG Complex. Simulated Annealing (SA) is first used to determine the initial hyperparameters which are then further optimized based on the performance of the model using Nelder-Mead simplex algorithm. The LS-SVR model is shown to outperform a benchmark model based on backpropagation neural networks (BPNN) in both training and testing data.

Keywords—artificial neural networks, industrial pollution, predictive algorithms, support vector machines

I. INTRODUCTION

POWER plants, chemical plants, government utilities and petroleum refineries typically produce more than the plant's capacity in order to meet demands. Hence these industries must continuously monitor their exhaust stacks for primary pollutants such as nitrogen oxides, carbon monoxide, sulfur dioxide, and carbon dioxide under regulations promulgated under the New Source Performance Standards (U.S. Environmental Protection Agency (EPA) PA 40 CFR Part 60) or the Clean Air Act Amendments Title IV (40 CFR Part 75)[1] and Malaysian Environmental Quality Act, 1978[2]. CEMS utilize a sample probe, umbilical and sample conditioning system to extract a representative sample of the stack gas exhaust stream to provide a continuous flow for direct measurement of the pollutant concentration on individual analyzers[3]. A data acquisition system (DAS) is typically used to collect, calculate emission rates, alarm, and store historical data from these continuous emissions monitoring systems (CEMS)[4]. The promulgated regulations in U.S. EPA 40 CFR covering the monitoring of combustion units for primary and other pollutants allow for the use of

predictive emissions monitoring systems (PEMS) in lieu of CEMS. PEMS is sophisticated software based on a sensor/prediction system that is directly interfaced with the process control system and inputs from the combustion or pollution control process. The U.S. EPA have revealed the devastating effects of the continuous release of carbon dioxide, methane, nitrous dioxide and other greenhouse (heat-trapping) gasses to the atmosphere[5]. Climate change induced by these gases can cause damage to human health, agriculture, natural ecosystems, coastal areas and other climate sensitive systems. Currently, emission monitoring is done via analytical instruments which are very expensive to install and maintain; the cost for an online NO_x analytical and monitoring system is around \$100,000 to \$200,000 and the cost for maintenance is approximately \$15,000 per year[6].

Several works have been done to develop predictive systems for industrial emissions. One of the earlier ideas was presented by G. Baines[7]; a consultant from Fisher-Rosemount Solutions. The author proposed the idea of predicting the stack contaminants in real time by correlating emissions with key unit parameters like fuel type, air and fuel flow and combustion temperature. S.S.S Chakravarthy, A.K Vohra and B.S Gill [8] have developed a PEMS for industrial process heaters. The authors have used heuristic optimizer genetic algorithm (GA) to tune the NO_x kinetic parameters. J. Deng and R. Stobart[9] incepted the idea of using a hybrid clustering technique that involves the modifications of Fuzzy C-means method and using neural networks to achieve the best performance of the fuzzy system; for a diesel engine emission model. L.Zheng, S. Yu, M. Yu [10] used generalized regression neural network (GRNN) to establish a non-linear model between the parameters of the boiler (of 300MW steam capacity) and the NO_x emissions. Later, the same authors proposed the idea of replacing the existing generalized regression neural network PEMS with least square support vector regression (LS-SVR) model. The authors claim that this new algorithm yields better accuracy of a coal combustion unit[11]. The main objective of this paper is to develop NO_x emission model of an acid gas incinerator based on least squares-support vector regression algorithm with Nelder-Mead optimization of its hyperparameters. This paper is organized as follows: Section II presents a brief literature on artificial neural network and least-squares support vector regression. Section III describes the modeling background in terms of the parameters used, case study of acid gas incinerator and the dataset used. Section IV presents the results and analysis and Section V gives a brief conclusion.

Rosdiazli Ibrahim is with the Universiti Teknologi PETRONAS Bandar Seri Iskandar, 31720 Tronoh, Perak, Malaysia (phone: 605-368-7821; fax: 605-365-7443; e-mail: rosdiazli@petronas.com.my).

Vijanth Sagayan Asirvadam with the Universiti Teknologi PETRONAS Bandar Seri Iskandar, 31720 Tronoh, Perak, Malaysia (phone: 605-368-7881; fax: 605-365-7443; e-mail: vijanth_sagayan@petronas.com.my).

Elangeshwaran Pathmanathan with the Universiti Teknologi PETRONAS Bandar Seri Iskandar, 31720 Tronoh, Perak, Malaysia (e-mail: elanz117@gmail.com).

II. LITERATURE REVIEW

A. Artificial Neural Network (ANN)

An ANN is represented as a non-linear interconnected layers of processing nodes which are normally referred to as neurons, a term borrowed from neurobiology [12]. The most common class of ANN is the multilayered feedforward network which primarily consist of input layer, one or more hidden layer and an output layer. The input layer holds the data and distributes them into the network via interconnections to neurons in the hidden layer(s) where they are processed by the activation function to obtain the output signal. This type of network is also known as multilayer perceptrons (MLP)[13]; a typical MLP network is shown in

$$y = A \quad (1)$$

$$y = \frac{1}{1 + e^{-A}} \quad (2)$$

$$y = \frac{2}{1 + e^{-2A}} - 1 \quad (3)$$

Where A , is the element activation function and it is represented by (4):

$$A = \sum_{i=1}^n w_i x_i \quad (4)$$

The variable w_i is the weight term and x_i is the network input. The network uses these weights to identify the strength of the interconnections between neurons. These weights are adjusted throughout the learning process. For MLP network, learning algorithms based on the gradient or Jacobian of the network error with respect to the weights is preferred because of their superior performance. A common Jacobian-based algorithm is the backpropagation algorithm. The backpropagation neural network however has been widely used to develop soft sensors for prediction of NO_x [14]. However, BPNN has some weaknesses, including the need for numerous controlling parameters, difficulty in obtaining a stable solution and the danger of overfitting. The solution shown by Zheng et al [10] points to the fact that BPNN is unreliable even if all of the network objects are pre-determined.

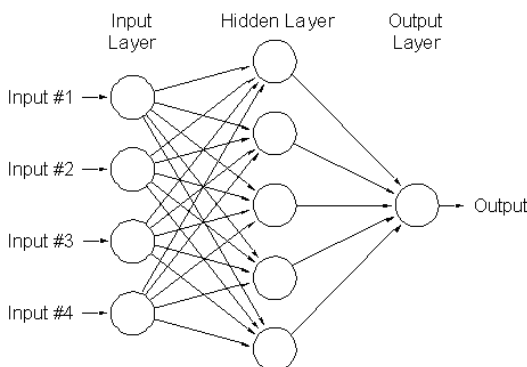


Fig. 1: Typical Backpropagation Neural Network

B. Least Squares Support Vector Regression (LS-SVR)

Standard support vector machine formulation leads to a quadratic programming (QP) problem with linear constraints. The size of the matrix involved in the QP problem is directly proportional to the size of the training data[11]. Therefore to reduce the complexity of the optimization problem, Suykens et al[15] introduced a modified version of SVM called least squares – SVM. LS-SVM formulation results in a set of linear equations instead of a quadratic programming problem. LS-SVM is used for both classification and regression problems. The formulation for LS-SVR starts by taking a training set and estimate using a non-linear function:

$f(x) = w^T \phi(x) + b$ where $\phi(\cdot): R^n \rightarrow R^{n_h}$ is a mapping function to a high dimensional and potentially infinite dimensional feature space; in this paper, there are 22 dimensions in the low dimensional space and 484 dimensions in high dimension space. Next, the optimization is formulated in primal weight space;

$$\min \Phi(w, e) = \frac{1}{2} w^T w + \gamma \frac{1}{2} \sum_{i=1}^l e_i^2$$

Subject to;

$$y_i = w^T \phi(x_i) + b + e_i \quad i = 1, \dots, l$$

The optimization formulation in (5) is ridge regression cost function formulated in feature space. Constructing the Lagrangian of the problem, the dual space problem is derived;

$$L(w, b, e; \alpha) = \Phi(w, e) - \sum_{i=1}^l \alpha_i \{w^T \phi(x_i) + b + e_i - y_i\}$$

The conditions for optimality are given by[15];

$$\begin{aligned} \frac{\partial L}{\partial w} = 0 &\rightarrow w = \sum_{i=1}^l \alpha_i \phi(x_i) \\ \frac{\partial L}{\partial b} = 0 &\rightarrow \sum_{i=1}^l \alpha_i = 0 \\ \frac{\partial L}{\partial e_i} = 0 &\rightarrow \alpha_i = \gamma e_i \quad i = 1, \dots, l \\ \frac{\partial L}{\partial \alpha_i} = 0 &\rightarrow w^T \phi(x_i) + b + e_i - y_i = 0 \quad i = 1, \dots, l \end{aligned} \quad (7)$$

Upon elimination of the variables w and e and solving in α and b the following solution in dual space is obtained

$$\begin{bmatrix} 0 & 1_v^T \\ 1_v & \Omega + 1/\gamma \end{bmatrix} \begin{bmatrix} b \\ \alpha \end{bmatrix} = \begin{bmatrix} 0 \\ y \end{bmatrix} \quad (8)$$

where $y = [y_1; \dots; y_l]$, $1_v = [1; \dots; 1]$ and $\alpha = [\alpha_1; \dots; \alpha_l]$. The “kernel trick”[16] is applied here as shown;

$$\begin{aligned} \Omega_{ij} &= \phi(x_i)^T \phi(x_j) \\ &= K(x_i, x_j) \quad i, j = 1, \dots, l \end{aligned} \quad (9)$$

Hence the resulting LS-SVR model becomes;

$$f(x) = \sum_{i=1}^l \alpha_i K(x, x_i) + b \quad (10)$$

In this paper, RBF kernel function is used;

$$K(x, x_i) = \exp\left(-\frac{|x - x_i|^2}{\sigma}\right) \quad (11)$$

where α_i and b are solutions to the linear system represented by (8). The LS-SVR formulation can be used to handle large datasets with no dimensionality problem. In (10), a kernel function is used to replace the high order mapping function. In this paper, the RBF kernel will be used exclusively for all computations involving kernel operations. In the case of RBF kernel, there are only two hyperparameters to be tuned, which is less than standard SVM.

III. MODELING BACKGROUND

A. BPNN Model

Two models will be developed in this paper using two distinctive algorithms. The first model is developed as a benchmark using BPNN. The optimal network parameters are chosen by varying the number of layers and number of hidden neurons per layer. The parameter that gives the best performance is chosen and shown below:

- Number of layers = 2
- No of neurons (hidden layer) = 20
- Transfer functions (input layer) = tan-sigmoid
- Transfer function (hidden layer) = linear
- Training algorithm = Lavenberg-Marquat

B. Nelder-Mead LS-SVR

It is understood that the hyperparameters involved for the standard SVM with RBF kernel are σ , C and ε . On the other hand, LS-SVR algorithm with RBF kernel involves only two hyperparameters; γ and σ [15]. The common method to optimize these hyperparameters is using the “grid-search” method which is a global exhaustive search technique. Based on try and error formulation, the hyperparameters are changed exponentially to find the ones that give the best performance for the model [17]. The grid-search is straightforward but it is naive, as there are other advanced methods which gives better performance results and saves computational cost. One such method is the Nelder-Mead simplex algorithm, which will be used in this paper. This algorithm is nicknamed the “amoeba” due to its biological-like search patterns. In 2-D, it consists of a search-triangle or “crawler” or “simplex” with three points that represent the highest (worst) point, next highest point and the lowest (best) point. Hence the intuition of this algorithm is to move away from high point towards the low point. The simplex moves in several transformations that are known as reflection, contraction, reflection and expansion and multiple contractions to find the optimal value for the minimization problem [18]. The initial values of the hyperparameters (γ and σ) is found using SA. This technique is borrowed

from metallurgy where it is a global optimizer for a large search space. SA is designed to find an optimized solution in a given time, rather than finding the best possible solution [19], this saves computation time and it is suitable for finding initial values for further optimizations. The performances of the models are gauged using standard performance functions in the form of correlation factor (R) and root means square error (RMSE);

$$RMSE = \sqrt{\frac{1}{n} \sum_{i=1}^n (\hat{X}_i - X_i)^2} \quad (12)$$

$$R = \frac{\sum_{i=1}^n (X_i - \bar{X})(\hat{X}_i - \bar{\hat{X}})}{\sqrt{\sum_{i=1}^n (X_i - \bar{X})^2} \sqrt{\sum_{i=1}^n (\hat{X}_i - \bar{\hat{X}})^2}} \quad (13)$$

where X_i is the predicted value, \hat{X}_i is the true value and n is the number of testing samples.

C. Case Study

In this paper, the NO_x emission from a tangentially fired acid gas incinerator is modeled. The incinerator train is part of an LNG complex. The plant is divided into four sections consisting of upstream facilities, gas treating, liquefaction and storage/terminal. The first part of the gas treating section deals with the acid gas in the feed. CO_2 and H_2S are removed to meet product specification. Amine-based solvent is used in the acid gas removal process. Solvent with absorbed acid gases are regenerated in regenerator column at high temperature and low pressure. The acid gases are then incinerated before being discharged safely to the environment. In this LNG complex, acid gases are incinerated using two methods; one is using steam boilers and the other is using acid gas thermal incinerators [20]. The process flow scheme of the incinerator train is shown in Fig.2. The main constituents to the incinerator are acid gas, flash gas, fuel gas and combustion air. The flue gas that are released to the stack consist of NO_x , SO_2 , SO_3 , CO , CO_2 and H_2S .

In this paper only NO_x emission will be modeled based on plant input and output process variable data. The data is obtained from the LNG complex incinerator train DCS' historical dataset taken from April 2010 to November 2010 and contains the data from 29 input process variables and 7 output process variables. The most relevant process variables are selected by reviewing the design and operational specifications in the incinerator material balance sheet. Initial correlation analysis was also performed to the dataset to determine the variables that have the strongest variance with each other. As a result, 22 input variables and one output variable (i.e. flue gas NO_x content) are chosen with 1068 number of samples, taken at 30 minutes apart for the whole month of October, 2010. Tables 1 and 2 outline the descriptions of the chosen input process variables the seven output variables respectively.

Before data are used for modeling, it is first pre-processed to remove bad inputs, non-values and outliers.

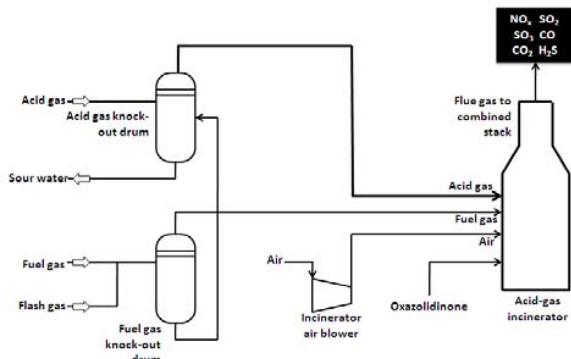


Fig. 2 PFS of incinerator train

TABLE I
SELECTED INPUT PROCESS VARIABLES

PROCESS VARIABLES	TAG NUMBER	ENGINEERING UNITS	OPERATION UNITS
A-91921 SOUR FEED GAS FLOW	7919_FICA201.MEAS	T/D	Incinerator Unit 2
FUEL GAS TO A91921	7919_FIC202.MEAS	%	Incinerator Unit 2
FUEL GAS TO INCINERATOR A-91921	7919_QR207.PNT	Density	Incinerator Unit 2
K-91921 SUCTION AIR FLOW	7919_FICA206.MEAS	T/D	Incinerator Unit 2
A-91921 STACK EXH TEMP	7919_TICA202.MEAS	DEGC	Incinerator Unit 2
A-91921 STACK EXH TEMP	7919_TICA204.MEAS	DEGC	Incinerator Unit 2
H2O ANALYSER A	10_QA361A.PNT	ppm	N/A
H2O ANALYSER B	10_QA361B.PNT	ppm	N/A
CO2 ANALYSER	10_QA364.PNT	%	N/A
H2S ANALYSER	10_QA367.PNT	ppm	N/A
C-91101 FEED GAS FLOW	7911_FT001.PNT	T/D	Flash Gas Unit
CO2 IN WET FEED GAS FR C91101	7911QRA001.PNT	ppm	Flash Gas Unit
H2S IN WET FEED GAS FR C91101	7911QRA002.PNT	ppm	Flash Gas Unit
C-91101 TREATED NG TEMP	7911_T1003.PNT	DEGC	Flash Gas Unit
C-91101 TREATED NG FLOW	7911_FR002.PNT	T/D	Flash Gas Unit
LEAN SLVT TO C91101 FLOW	7911_FICA015.MEAS	T/D	Flash Gas Unit
C-91103 SOLVENT REFLUX FLOW	7911_FICA035.MEAS	T/D	Sour Water Unit
HPF/G TO KG91420 FLOW	7914_FT073.PNT	T/D	Gas Turbine Unit
MR IGV POSITION FEEDBACK	7914GI318.PNT	N/A	Gas Turbine Unit
MR TURBINE SPEED	7914SICA300.PNT	N/A	Gas Turbine Unit
MR COMB REFERENCE TEMP	7914TI3006.PNT	DEGC	Gas Turbine Unit
MR MWATT ACTUAL POWER	7914XI334.PNT	MWATT	Gas Turbine Unit

TABLE II
OUTPUT PROCESS VARIABLES (ONLY NO_x IS SELECTED)

PROCESS VARIABLES	TAG NUMBER	ENGINEERING UNITS	OPERATION UNITS
A-91921 FLUE GAS O2 CONTENT	7919_OICA204.MEAS	mol%	Incinerator Common Stacks
A-91921 FLUE GAS NO _x CONT	7919QR201.PNT	mg/m ³	Incinerator Common Stacks
A-91921 FLUE GAS SO ₂ CONT	7919QR202.PNT	ppmv	Incinerator Common Stacks
A-91921 CO CONTENT	7919QR205.PNT	mg/m ³	Incinerator Common Stacks
A-91921 CO ₂ CONTENT	7919QR206.PNT	%	Incinerator Common Stacks
A-91921 FLUE GAS H ₂ S CONT	7919QRA203.PNT	ppm	Incinerator Common Stacks
SO ₃ CONTENT	7919_QR208.PNT	ppm	Incinerator Common Stacks

For both models, 70% of the data is reserved for training, 10% for validation (i.e. crossvalidation for LS-SVR) and 20% for testing.

IV. RESULTS AND ANALYSIS

The individual model performance of BPNN and LS-SVR will be presented in this section. Tables 3 and 4 presents a comparison of the performance of the models in terms of correlation, root means squared error and accuracy between real and predicted values. The performance of both models in terms of computational time is also shown. Fig. 3, 4, 5 and 6 show how each model is able to track the real value in both

training and testing data. This will be followed by a brief analysis of the results obtained.

TABLE III
PERFORMANCE OF BPNN MODEL

	RMSE	R	Accuracy	Time
Training Data	0.4516	0.9470	95.63%	21.0 sec
Testing Data	0.4810	0.9448	95.03%	

TABLE IV
PERFORMANCE OF LS-SVR MODEL

	RMSE	R	Accuracy	Time
Training Data	0.2680	0.9820	97.60%	65.1 sec
Testing Data	0.4530	0.9516	95.58%	

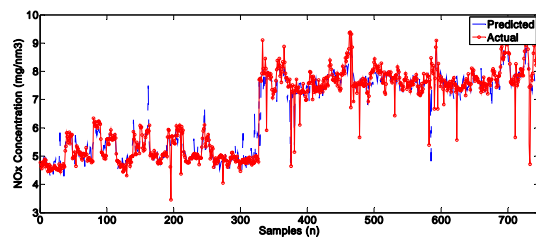


Fig. 3 NO_x training data for BPNN

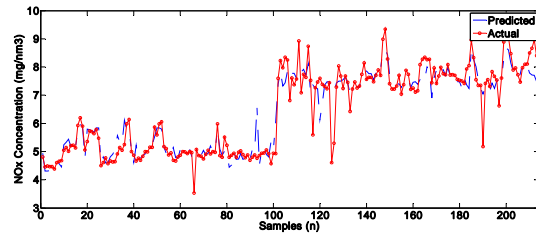


Fig. 4 NO_x testing data for BPNN

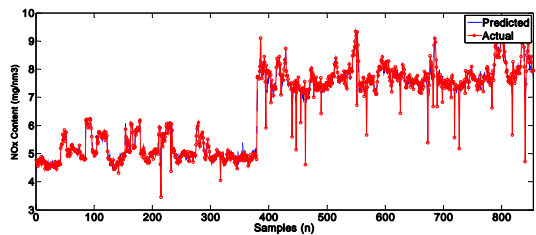


Fig 5 NO_x training and cross validation data for LS-SVR

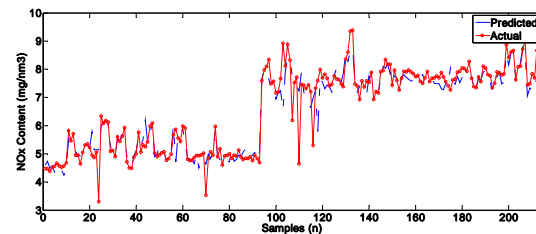


Fig. 6 NO_x testing data for LS-SVR

The performance of the LS-SVR model depends greatly on the values of the hyperparameters selected. The initial values for the hyperparameters are: $\gamma = 34.84$ and $\sigma = 11.89$, and was computed using SA. These values were then used for further optimization using Nelder-Mead simplex algorithm.

The objective function is to minimize model error (MSE) based on several constraints such as maximum number of optimization steps, maximum number of function evaluations, stopping criterion based on the relative change in value of the function in each step and stopping criterion based on the change in the minimizer in each step. Table 5 shows the simplex computation for this model.

The optimized values for the hyperparameters are:

- $\gamma = 32.96$
- $\sigma = 11.43$

TABLE V
HYPERPARAMETERS OPTIMIZATION STEPS

Iteration	Function Evaluation	min f(x)	log(γ)	log(σ)	Procedure
1	3	1.413835e-001	3.5508	2.4753	initial
2	5	1.413835e-001	3.5508	2.4753	contract inside
3	7	1.413835e-001	3.5508	2.4753	contract outside
4	9	1.413835e-001	3.5508	2.4753	contract inside
5	10	1.413835e-001	3.5508	2.4753	reflect
6	12	1.413835e-001	3.5508	2.4753	contract inside
7	14	1.413835e-001	3.5508	2.4753	contract outside
8	16	1.413835e-001	3.5508	2.4753	contract inside
9	17	1.413835e-001	3.5508	2.4753	reflect
10	18	1.413835e-001	3.5508	2.4753	reflect
11	20	1.413835e-001	3.5508	2.4753	contract inside
12	22	1.413835e-001	3.5508	2.4753	contract inside
13	23	1.413835e-001	3.5508	2.4753	reflect
14	25	1.413743e-001	3.4954	2.4364	reflect
15	27	1.413743e-001	3.4954	2.4364	contract inside

The NO_x emission as shown in Fig. 3, 4, 5 and 6 presents a highly non-linear distribution; hence it takes a model with the capabilities to map these nonlinearities precision and accuracy.

As shown in Tables III and IV, the performance of the LS-SVR model is better in both training and testing data compared to the BPNN model. The graphs also show that the LS-SVR model is able to track and predict NO_x emission with much better accuracy than BPNN model. This could be because LS-SVR is a much more 'transparent' algorithm where the resultant model has weights and biases that were optimized to suit the particular dataset. Another plausible explanation is that, with BPNN, the initial weights are chosen randomly and hence the performance varies significantly with the number of simulations as shown by Zheng et al [10]. In contrast, LS-SVR initial parameters are optimized via SA. The solutions provided by support vector machines are unique and global in a dual space problem; this is achieved by solving the Karush-Kuhn Tucker (KKT) system at its core.

SVM algorithms are a kernel based method; hence the complexity is in the order of $O(n^3)$ which means that the computational power and required running time is higher than neural network based methods. Moreover, the LS-SVR solution comes from solving the linear system in (8) by matrix inversion; this is a fairly tedious process to be solved numerically and results in a longer overall computation time

as shown in Table 4. Hence, the usability of LS-SVR depends heavily upon the number of samples used and the processing power of the machine that it currently runs on. To overcome this, several fixes have been proposed such as using quadratic Renyi entropy to select the most significant support vectors [21], sequential learning LS-SVM [22] and using analytic quadratic programming and sparseness [23].

V. CONCLUSION

In a nutshell, this paper has brought to focus the ability to model the NO_x emission from an acid-gas incinerator using a Nelder-Mead LS-SVR algorithm. The modeling was done using a series of steps that includes optimizing initial hyperparameters and further optimization using the Nelder-Mead simplex algorithm. As a result, the LS-SVR model performs significantly better for both training and testing data, in comparison with the benchmark BPNN model. Additionally, the ability to track and predict future values of NO_x emission with remarkable accuracy has also been demonstrated by the LS-SVR model. The superiority of the LS-SVR model is mostly accounted to the ability to reach a global and unique solution for the minimization of a convex function. It must be mentioned that the proposed algorithm is robust in terms of the class of the problem that it can handle, be it classification or complex regression with multiple dimensions. However, one of the drawbacks of LS-SVR includes heavy computational dependencies when it comes to large datasets. Nevertheless this could be improved using the latest techniques available such as quadratic Renyi entropy and sequential learning LS-SVM. Overall, the primary objective of the paper has been achieved, and in the future a hybrid model that involves both neural network and support vector machines will be developed in order to further improve the predictive accuracy and computational efficiencies.

ACKNOWLEDGMENT

Authors would like to thank UTP for the graduate assistant scheme program to fund the research and PETRONAS for the project collaboration.

REFERENCES

- [1] U.S Environmental Protection Agency. Clean Air Act as of 2008. *Chapter 85: Air Pollution Prevention and Control*. s.l. : U.S Government Printing Office, 2008.
- [2] ENVIRONMENTAL QUALITY (CLEAN AIR) REGULATIONS 1978. *FEDERAL SUBSIDIARY LEGISLATION ENVIRONMENTAL QUALITY ACT 1974 [ACT 127]*. s.l. : Department of Environment, Malaysia, 2000.
- [3] *Design CEMS For Flue Gas From Thermal Power Plant*. Fan Xiaoliang, Zheng Haiming. Baoding, China : IEEE, 2009.
- [4] *Developing Data Acquisition and Handling System for Continuous Emission Monitoring System from Coal-Fired Power Plant*. Haiming Zheng, Guiji Tang. Baoding, China : IEEE, 2008.
- [5] US Environmental Protection Agency. Climate Change - Health and Environmental Effects. *US EPA Home Page*. [Online] [Cited: April 8, 2011.] <http://www.epa.gov/climatechange/effects/index.html>.
- [6] *Emission Monitoring Using Multivariate Soft Sensors*. Dong, Dong and McAvoy, Thomas J. Seattle, Washington : American Control Conference, , 1995.

- [7] *Neural Networks for Boiler Emission Prediction*. Baines, Glenn. s.l.: Performance Consultant Fisher-Rosemount Solutions, 1999, pp. 435-439.
- [8] *Predictive emission monitors (PEMS) for NO_x generation in process heaters*. S. S. S. Chakravarthy, A. K. Vohra, B. S. Gill. Gurgaon, India: Elsevier, 2000, Computers and Chemical Engineering 23 (2000), pp. 1649-1659.
- [9] *Combined Hybrid Clustering Techniques and Neural Fuzzy Networks to Predict Diesel Engine Emissions*. Jiamei Deng, Richard Stobart. Brighton, UK: IEEE, 2007.
- [10] *Monitoring NO_x Emissions from Coal-Fired Boilers using Generalized Regression Neural Network*. Ligang Zheng, Shuijun Yu, Minggao Yu. Jiaozuo Henan, China: IEEE, 2008, pp. 1916-1919.
- [11] *Prediction of NO_x Concentration from Coal Combustion Using LS-SVR*. Ligang Zheng, Hailin Jia, Shuijun Yu, Minggao Yu. Jiaozuo Henan, China: IEEE, 2010, pp. 1-4.
- [12] *Modeling and optimization of the NO_x emission characteristics of a tangentially fired boiler with artificial neural networks*. Hao Zhou, Kefa Cen, Jianren Fan. Hangzhou, PR China: Science Direct, 2001, Energy 29 (2004) 167-183, pp. 167-183.
- [13] S., Haykins. *Neural networks: a comprehensive foundation*, 2nd ed. Englewood Cliffs, NJ: Prentice-Hall, 1999.
- [14] *Monitoring pollutant emissions in a 4.8 MW power plant through neural network*. Tronci, S., Baratti, R. and Servida, A. 2002, Neurocomputing, Vol. 43, pp. 3 - 15.
- [15] J.A.K Suykens, T.V. Gestel, J.D Brabenter, B.D Moor, J. Vandewelle. *Least Squares Support Vector Machines*. NJ 07661: World Scientific Publishing, 2002.
- [16] N, Cristianini and J, Shawe-Taylor. *An introduction to support vector machine and other kernel-based learning method*. Cambridge: Cambridge University Press, 2000.
- [17] Chih-Wei Hsu, Chih-Chung Chang, and Chih-Jen Lin. *A Practical Guide to Support Vector Classi*. Department of Computer Science, National Taiwan University, Taipei 106, Taiwan. 2010.
- [18] Teukolsky, Vetterling, Flannery. *Numerical Recipes in C*. 2nd Edition. Cambridge University Press: s.n., 1998.
- [19] *Optimization by Simulated Annealing*. S. Kirkpatrick, C. D. Gelatt and M. P. Vecchi. 4598, s.l.: American Association for the Advancement of Science, May 13, 1983, Science, New Series, Vol. 220, pp. 671-680.
- [20] S.Jamaludin, S.Manaf, P.Oortwin. *World Largest Tangentially Fired Acid Gas Incinerator in LNG Plant: Startup and Operational Experiences*. Malaysia LNG Sdn. Bhd & Shell Global Solutions International. 2005. Technical Report.
- [21] *Adaptive and Iterative Least Squares Support Vector Regression Based on Quadratic Renyi Entropy*. Jingqing Jiang, Chuyi Song, Haiyan Zhao, Chunguo Wu, Yanchun Liang. Beijing, China: s.n.
- [22] Polani, Tobias Jung and Daniel. *Sequential Learning with LS-SVM for Large-Scale Data Sets*. Dept. of Computer Science, Univ. of Mainz. Mainz, Germany: s.n. Technical Report.
- [23] *Using Analytic QP and Sparseness to Speed Training of Support Vector Machines*. Platt, John C. 11, 1999, Advances in Neural Information Processing Systems.



Elangeshwaran Pathmanathan was born in Johor. He holds a B.Hons in Electrical & Electronics Engineering, Universiti Teknologi Petronas, Perak, Malaysia in 2010, currently pursuing M.Sc in Electrical & Electronics Engineering at the same university.



He was a Field Engineer for Instrumentation at Malaysia Marine and Heavy Engineering, during his industrial internship training from Dec 2008 until July 2009. His published articles are "Development of Predictive Emission Models for Various Applications using ANN" - 2011 International Conference on Systems Engineering and Modeling (ICSEM 2011), March 11 – 13, 2011 and "Development of CO₂ Emission Model of an Acid-Gas Incinerator using Nelder-Mead LS-SVR" - Transactions of The Institute of Measurement and Control (TIMC), October 2011. Elangeshwaran Pathmanathan is a member of Board of Engineers, Malaysia.

Rosdiazli Ibrahim received the BEng. Electrical Engineering, from Univeristi Putra Malaysia in 1996. In 2000, he awarded a Master of Science in Automation and Control from the University of Newcastle Upon-Tyne, UK with Distinction. He was conferred a PhD degree in Electrical & Electronic Eng. from the University of Glasgow, UK in 2008.

He joined Universiti Teknologi PETRONAS in 1999 and currently is a Senior Lecturer in the Electrical & Electronic Engineering department. Formerly, he was an Instrument Engineer at PETRONAS Fertilizer (Kedah) Sdn. Bhd. He has presented and published several articles in the area of intelligent control and nonlinear multivariable process modeling which is very much in line with his research interest.



Vijanth Sagayan Asirvadam is from an old mining city in Malaysia, called Ipoh. He studied at the University of Putra, Malaysia for the Bachelor Science, BSc. (Hon) majoring in Statistics and graduated in April 1997. He received his Master's Science, MSc. degree in Engineering Computation with a Distinction in December 1998. He took employments as a system administrator at the Multimedia University (MMU) Malaysia prior joining the Intelligent Systems and Control Research Group at Queen's University Belfast in November 1999 where he completed his Doctorate (Ph.D.) in March 2003, researching on Online and Constructive Neural Learning methods.

Dr Vijanth took previous academic employments as a lecturer at the Multimedia University Malaysia from 2003-2005 and as a Senior Lecturer at the AIMST University from 2005-2006. He serves as an academic staff at the department of electrical and electronics engineering, Universiti Teknologi PETRONAS since November 2006 as a senior lecturer from 2006-2011 and currently serve as an Associate Professor.

Dr Vijanth research interest includes linear and nonlinear system identification, model validation and application of intelligent system in computing, signal and image processing. Dr Vijanth is member of Institute of Electrical and Electronics Engineering (IEEE) and Institute of Engineering Technology (MIET). He has over 90 publications in local and international journal and conference proceedings.