

Technique for Grounding System Design in Distribution Substation

N. Rugthaicharoencheep, A. Charlangsut, B. Ainsuk, and A. Phayomhom

Abstract—This paper presents the significant factor and give some suggestion that should know before design. The main objective of this paper is guide the first step for someone who attends to design of grounding system before study in details later. The overview of grounding system can protect damage from fault such as can save a human life and power system equipment. The unsafe conditions have three cases. Case 1) maximum touch voltage exceeds the safety criteria. In this case, the conductor compression ratio of the ground grid should be first adjusted to have optimal spacing of ground grid conductors. If it still over limit, earth resistivity should be consider afterward. Case 2) maximum step voltage exceeds the safety criteria. In this case, increasing the number of ground grid conductors around the boundary can solve this problem. Case 3) both of maximum touch and step voltage exceed the safety criteria. In this case, follow the solutions explained in case 1 and case 2. Another suggestion, vary depth of ground grid until maximum step and touch voltage do not exceed the safety criteria.

Keywords—Grounding System, Touch Voltage, Step Voltage, Safety Criteria.

I. INTRODUCTION

GROUNDING systems for substation is the important countermeasure to maintain the safe and reliable operation of power system and ensure the safety of power apparatus and operators. But have many details for design, so this paper will consider with only significant factor that included the earth resistivity, safety criteria, ground potential rise (GPR), design procedure, calculating equation and have suggestion for design. The safety design is complete when the GPR is less than touch voltage criteria. If it is not less than the criteria, so mesh and step voltage are need to calculate for compare with the safety criteria later. If mesh voltage and step voltage are less than the safety criteria, then the safety design is totally complete. But if it not at least one condition, the modify design is necessary for get the acceptable condition

Nattachote Rugthaicharoencheep is with the Department of Electrical Engineering, Faculty of Engineering, Rajamangala University of Technology Phra Nakhon, Bangkok, 10800, Thailand (phone: 662 913-2424 ext. 150; fax: 662 913-2424 ext. 151; e-mail: nattachote@ieec.org).

Aroon Charlangsut is with the Department of Electrical Engineering, Faculty of Engineering, Rajamangala University of Technology Phra Nakhon, Bangkok, 10800, Thailand (phone: 662 913-2424 ext. 150; fax: 662 913-2424 ext. 151; e-mail: aroon.c@rmutp.ac.th).

Boonserm Ainsuk is with the Department of Electrical Engineering, Faculty of Engineering, Rajamangala University of Technology Phra Nakhon, Bangkok, 10800, Thailand (phone: 662 913-2424 ext. 150; fax: 662 913-2424 ext. 151; e-mail: b.ainsuk02@gmail.com).

Att Phayomhom is with the Power System Planning Department, Metropolitan Electricity Authority (MEA), Bangkok, 1192, Thailand (phone: 662 348-5549; fax: 662 348-5133; e-mail: attp@mea.or.th).

such as decrease total grid resistance by deep driven rods, closer spacing of grid conductor, decrease fault clearing time, etc. and the calculation and comparison processes are repeated [1-2].

II. SIGNIFICANT FACTOR

A. Earth Resistivity

Table I shows typical ranges of resistivity for various soils and should be used only for comparison purpose. Although have many several method for measuring but the mostly accurate and used is four point method or Wenner arrangement. Wenner arrangement is shown In Fig.1. Four electrodes are buried in equally space at point C₁, C₂, P₁, and P₂.

TABLE I
RANGE OF EARTH RESISTIVITY

Type of Earth	Average Resistivity ($\Omega\cdot m$)
Wet Organic Soil	10
Moist Soil	100
Dry Soil	1000
Bed Rock	10000

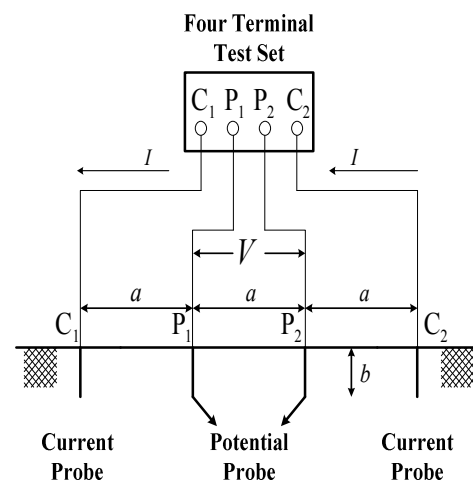


Fig. 1 Wenner arrangement

The resistance R in ohm determine by V/I . Where I is current pass between two outer electrodes and V is voltage between two inner electrodes [2-5].

B. Ground Potential Rise (GPR)

The GPR is equal to the product of the station ground grid impedance and that portion of the total fault current that flows through it [6].

C. Safety Criteria

The safety of a person depends on preventing the critical amount of shock energy. The safety criteria are very important value. It should be first thing for calculate to specific a safety level, then the maximum touch and step voltage are calculated to compare with the safety criteria to define it is safe or unsafe [2-4].

D. Maximum Touch and Step Voltage

Step voltage is defined as the voltage different between distant of 1 m with the feet without contacting [2].

Touch voltage is defined as the voltage different between ground potential rise and the surface potential at the point where a person is standing while at the same time having a hand in contact with a grounded structure [4] [7].

Step voltage and touch voltage are used to determine if a grounding system is safe for people and equipment. Both of them should not exceed the limit for safety [4].

III. CALCULATING PROCEDURE [2],[8-10]

A. Earth Resistivity

The resistivity ρ in the terms of the length units in which a and b are measured is

$$\rho_a = \frac{4\pi aR}{1 + \frac{2a}{\sqrt{a^2 + 4b^2}} - \frac{a}{\sqrt{a^2 + b^2}}} \quad (1)$$

- where ρ_a = apparent resistivity of the soil ($\Omega\cdot m$)
- R = resistance (Ω)
- b = depth of the electrodes (m)
- a = distance between two adjacent electrodes (m)

If b is small compared to a. Equation (1) can be reduced to equation (2).

$$\rho_a = 2\pi aR \quad (2)$$

Two-layer soil model is shown in Fig. 2 resistivity determination using the Wenner method. In this method the resistivity can calculate by equation (3).

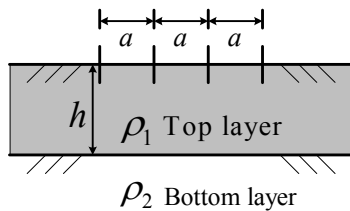


Fig. 2 Two-layer soil

$$\rho_a = \rho_1 \left(1 + 4 \sum_{i=1}^{\infty} \frac{K^n}{\sqrt{1 + \left(2n \frac{h}{a}\right)^2}} - \frac{K^n}{\sqrt{4 + \left(2n \frac{h}{a}\right)^2}} \right) \quad (3)$$

$$K = \frac{\rho_2 - \rho_1}{\rho_2 + \rho_1} \quad (4)$$

- where ρ_1 = top layer resistivity ($\Omega\cdot m$)
- ρ_2 = bottom layer resistivity ($\Omega\cdot m$)
- h = top layer height (m)
- K = reflection coefficient

B. Ground Potential Rise

Ground Potential Rise is determine from equation (5)

$$GPR = I_G \cdot R_g \quad (5)$$

- where I_G = maximum rms current flowing between ground grid and earth (A)

$$R_g = \text{resistance of grounding system } (\Omega)$$

C. Safety Criteria

Step Voltage Criteria is

$$E_{\text{step}} = (1000 + 6C_S \cdot \rho_S) \frac{k}{\sqrt{t_S}} \quad (6)$$

Similarly touch voltage criteria is

$$E_{\text{touch}} = (1000 + 1.5C_S \cdot \rho_S) \frac{k}{\sqrt{t_S}} \quad (7)$$

$$C_S = 1 - \frac{0.09 \left(1 - \frac{\rho}{\rho_S}\right)}{2h_S + 0.09} \quad (8)$$

- where E_{step} = step voltage (V)
- E_{touch} = touch voltage (V)
- C_S = surface layer derating factor
- ρ_S = surface material resistivity ($\Omega\cdot m$)
- k = 0.116 for 50 kg body weight
0.157 for 70 kg body weight
- t_S = duration of shock current (s)
- h_S = the thickness of the surface material (m)
- E_{step} = step voltage (V)
- E_{touch} = touch voltage (V)
- C_S = surface layer derating factor

If no protective surface layer is used, then

$$C_s = 1$$

$$\rho_s = \rho$$

D. Maximum Touch and Step Voltage

The Maximum touch voltage within a mesh of a ground grid is calculated by

$$E_m = \frac{\rho_a \cdot K_m \cdot K_i \cdot I_G}{L_M} \tag{9}$$

- where E_m = Mesh voltage (V)
- ρ_a = apparent resistivity of the soil ($\Omega\cdot m$)
- K_m = Mesh factor defined for n parallel conductors
- K_i = Corrective factor for current irregularity
- L_M = Effective length for mesh voltage (m)

The step voltage is determine from

$$E_s = \frac{\rho_a \cdot K_s \cdot K_{ii} \cdot I_G}{L_s} \tag{10}$$

- where E_s = step voltage (V)
- K_s = Step factor defined for n parallel conductors
- L_s = Effective length for step voltage (m)

IV. DESIGN PROCEDURE

Step for design. The detail in each step can find in the reference shown in Figure 3 [2].

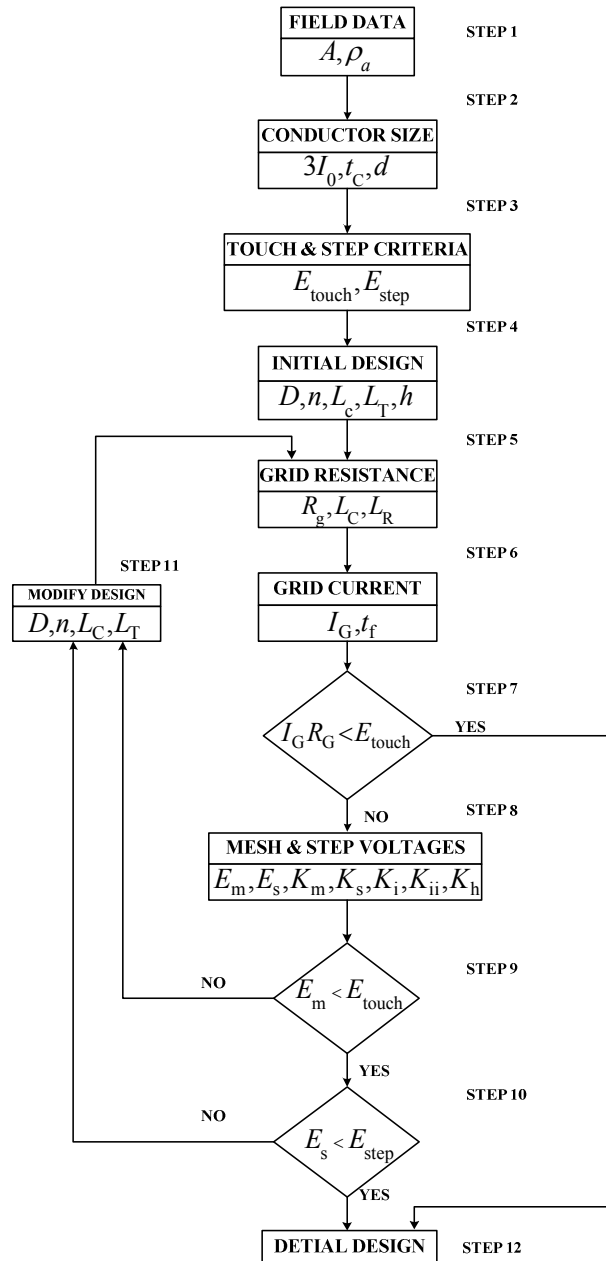


Fig. 3 Step for Design Procedure

V. SUGGESTION

- A) Sometimes the problems either step 9 or step 10 in fig 3 is happened or both. The modify design is necessary for solve this problem. Have many solutions for solve it such as reduce ground resistance, add multiple electrodes in parallel. The resistance can be reduced further by using chemical electrodes. The preferred chemical electrode consists of the rod placed in concrete [11].
- B) In the other way earth resistivity, GPR, safety criteria, maximum mesh and step voltage can achieve by computer program for convenience, such as

- Current Distributed Electromagnetic Interference Grounding and Soil Structure (CDEGS) program.
- C) Grounding system with unequal spacing conductor is better than equal spacing conductor [12].
- D) Number of ground rod does not have an effect with mesh voltages [13].
- E) In raining season, touch voltage probably higher than the limit value, so the influence of raining season should be considered [14].
- F) The unsafe conditions have three cases. Case 1) maximum touch voltage exceeds the safety criteria. In this case, the conductor compression ratio of the ground grid should be first adjusted to have optimal spacing of ground grid conductors. If it still over limit, earth resistivity should be consider afterward. Case 2) maximum step voltage exceeds the safety criteria. In this case, increasing the number of ground grid conductors around the boundary can solve this problem. Case 3) both of maximum touch and step voltage exceed the safety criteria. In this case, follow the solutions explained in case 1 and case 2. Another suggestion, vary depth of ground grid until maximum step and touch voltage do not exceed the safety criteria.

VI. CONCLUSION

All of factor above are elementary things that should know before design of grounding system in substation that mean a safe design has been obtained. On the other hand, if design without a knowledge of significant factor for grounding system. The disaster will happen when a fault occurs in the substation. It can harm the personnel who work in the substation or nearby by step voltage or touch voltage and the GPR will increase to high can damage intelligent electronic devices and electronic controller.

ACKNOWLEDGMENT

The authors would like to express his gratitude to Rajamangala University of Technology Phra Nakhon, Thailand for support.

REFERENCES

- [1] T. Thasananutariya, K. Spuntupong, and S. Chatratana, "Design of Grounding System for GIS Indoor Substation", in Proc. TENCON IEEE Region 10 Conf. pp. 413 – 416, 2004.
- [2] IEEE Std 80-2000, "IEEE Guide for Safety in AC Substation Grounding", 2000.
- [3] ANSI/IEEE Std 81-1983, "IEEE Guide for Measuring Earth Resistivity, Ground Impedance, and Earth Surface Potentials of a Ground System", 1983.
- [4] A. Phayomhom, S. Sirisumranikul, T. Kasirawat and A. Puttarach, "Safety Design Planning of Ground Grid for Outdoor Substation in MEA's Power Distribution System", in Proc. Electrical Engineering/Electronics Computer Telecom. and Information Technology International Conf. pp. 298-302, 2010.
- [5] P. A. Zotos, "Ground Grid Design in Large Industrial Plants", IEEE Tran. Industry Applications, vol. 24, no. 3, pp.521-525, May/June, 1988.
- [6] IEEE Std 367-1996, "IEEE Recommended Practice for Determining the Electric Power Station Ground Potential Rise and Induced Voltage From a Power Fault", 1996.
- [7] M. Mitolo, P. E. Sutherland and R. Natarajan, "Effects of High Fault Currents on Ground Grid Design", IEEE Trans. Industry Applications, vol. 46, no. 3, May/June, 2010
- [8] A. Puttarach, N. Chakpitak, T.Kasirawat, and C. Pongsriwat, "Substation Grounding Grid Analysis with the Variation of Soil layer depth Method", in Proc. IEEE Lausanne, Power Tech. pp. 1881-1886, 2007.
- [9] H. M. Khodr, G. A. Salloum, J. T. Saraiva, and M.A. Matos, "Design of grounding systems in substations using a mixed-integerlinear programming formulation", Electric Power Systems Research, Vol. 79, pp. 126-133, 2007.
- [10] A. Phayomhom, S. Sirisumrannukul, T.Kasirawat, A. Puttarach, C. Klinsopon, and P. Pearnont, "Safety Analysis for Grounding System of Two Neighbouring Substations: Case Study of Metropolitan Electricity Authority's System", GMSARN International Journal 5 pp. 169 – 178, 2011.
- [11] Marcus O. Durham, and Robert A. Durham, "Grounding System Design for Isolated Locations and Plant Systems", in Proc. Petroleum and chemical Industry Conf. pp. 145-153, 1995.
- [12] Yanqing GAO, Rong Zeng, Xidong Liang, Jinliang HE, Weimin Sun and Qi SU, "Safety Analysis of Grounding Grid for Substation with Different Structure", In Proc. Power System Tech. International Conf. pp. 1487-1492, 2000.
- [13] F. Dawalibi, and D. Mukhedkar, "Optimum Design of Substation Grounding in a Two Layer Earth Structure Part III Study of Grounding Grids Performance and new Electrodes Configuration", IEEE Tran. Power Apparatus and Systems, vol. 94, no. 2, pp. 267-282, March/April, 1975.
- [14] Jinliang He, Rong Zeng, Yanqing Gao, Youping Tu, Weimin Sun, Jun Zou, and Zhicheng Guan, "Seasonal Influences on Safety of Substation Grounding System", IEEE Tran. Power Delivery, vol. 18, no. 3, pp. 788-795, July, 2003.

Nattachote Rugthacharoencheep (M'10) received his Ph.D. in Electrical Engineering from King Mongkut's University of Technology North Bangkok (KMUTNB), Thailand in 2010. He is currently a lecturer at the Department of Electrical Engineering, Faculty of Engineering Rajamangala University of Technology Phra Nakhon (RMUTP), Bangkok, Thailand. His research interests include power system operation, optimization technique, and distributed generation.

Aroon Charlangsut is currently a lecturer at the Department of Electrical Engineering, Faculty of Engineering Rajamangala University of Technology Phra Nakhon (RMUTP), Bangkok, Thailand. His research interests include power system operation, renewable energy and power engineering education.

Boonserm Ainsuk is currently working toward for B.Eng. degree in Electrical Engineering at Rajamangala University of Technology Phra Nakhon (RMUTP), Bangkok, Thailand. His research interests include power system operation and grounding system design.

Att Phayomhom received Ph.D. degree in the Electrical Engineering Department from the King Mongkut's University of Technology North Bangkok (KMUTNB), Thailand in 2010. He has worked for Power System Planning Department of Metropolitan Electricity Authority (MEA) Thailand since 1996. He is responsible for power system planning. His main research interests are power system planning, safety design of ground grid in substation and lightning performance.