

# Effect of DG Installation in Distribution System for Voltage Monitoring Scheme

S. R. A. Rahim, I. Musirin, M. M. Othman, M. H. Hussain

**Abstract**—Loss minimization is a long progressing issue mainly in distribution system. Nevertheless its effect led to temperature rise due to significant voltage drop through the distribution line. Thus, compensation scheme should be proper scheduled in the attempt to alleviate the voltage drop phenomenon. Distributed generation has been profoundly known for voltage profile improvement; provided that over-compensation or under-compensation phenomena are avoided. This paper addresses the issue of voltage improvement through different type DG installation. In ensuring optimal sizing and location of the DGs, pre-developed EMEFA technique was made use for this purpose. Incremental loading condition subjected to the system is the concern such that it is beneficial to the power system operator.

**Keywords**—Distributed generation, EMEFA, power loss, voltage profile.

## I. INTRODUCTION

VOLTAGE drop problem may cause insecure power delivery to consumer. The consequence of voltage drop is loss increment in the whole system. Thus it requires compensating scheme such as static var compensation (SVC) [1], compensating capacitor [2] and distributed generation (DG) [3]. Nowadays, DG is the most commonly used scheme in distribution system. This requires optimization processes such as Genetic Algorithm (GA) [4], Evolutionary Programming (EP) [5], Particle Swarm Optimization (PSO) [6], [7] and Firefly Algorithm (FA) [8].

DG can be categorized as renewable and nonrenewable energy resources. Renewable energy resources comprise of biomass, wind power plants, solar or photovoltaic (PV) generation while technologies that utilize nonrenewable or conventional energy resources included hydro power, gas turbines (GT), fuel cells (FC) and microturbines [9], [10]. DG can be divided into four categories based on the rating of generation source including micro DG (1 W–5 kW), small DG (5 kW–5 MW), medium DG (5 MW–50 MW), and large DG (50 MW–300 MW).

Generally, distribution systems are significantly designed to operate without any generation on the customer sites or at the distribution line. By incorporating DG into distribution

systems, it can affect the voltages and power flows and may also contribute towards loss reduction. The increased interest in DG has influenced the development in DG technologies, grid support and expansion of network in distribution system. Decision or determining on DG placement and sizing are to be considered as important factor to ensure maximum benefits. Although the installation and exploitation of DGs to solve network problems has been debated in distribution networks; in most cases, the distribution system operator (DSO) has no control or influence about DG location and size below a certain limit [3]. If the implementation of DG placement is not appropriately done, it may increase the losses which lead to temperature rise on the cable and can cause low or over voltage to the system. It can eventually result an increase in costs of operation [11].

Most studies in the determining the optimal output of DG has only focused on loss minimization without considering the types of DG. This paper presents the effect of DG installation in distribution system for voltage monitoring scheme. It addresses the issue of voltage improvement and loss reduction through different type of DG installation in distribution system. In achieving optimal parameters of the compensating devices, a pre-developed EMEFA was employed. Results from the study revealed the robust capability of EMEFA in making sure that the compensating process does not cause over-compensated and under-compensated.

## II. THE EVOLUTION OF DG TECHNOLOGIES

Along with the rapid development of DG technology into the distribution system, it is important to study the different types of DG. DG can be modeled as voltage controlled bus (PV) or complex power injection bus (PQ)[12]. The different types of the DGs can be characterized in four types as shown in Fig. 1. Fig. 2 illustrates the specific topics on DG types for PV and GT from the year 2000 till year 2013. The increasing number of published papers on the DG installation in distribution system shows that this study is still relevant in power system.

S. R. A. Rahim is with the School of Electrical System Engineering at Universiti Malaysia Perlis (UniMAP). Currently, she is a PhD candidate at Universiti Teknologi MARA (e-mail: rafidah@unimap.edu.my).

I. Musirin is with The Faculty of Electrical Engineering, Universiti Teknologi MARA, 40450 Shah Alam, Malaysia (e-mail: ismailbm@salam.uitm.edu.my).

M. M. Othman is with The Faculty of Electrical Engineering, Universiti Teknologi MARA, 40450 Shah Alam, Malaysia.

M. H. Hussain is with the school of Electrical System Engineering at Universiti Malaysia Perlis (UniMAP) (e-mail: muhddatta@unimap.edu.my).

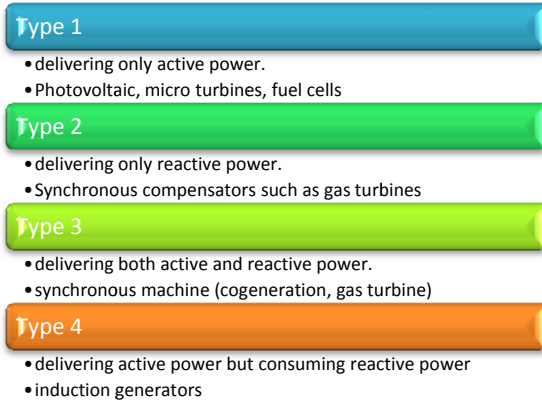


Fig 1 Types of DG

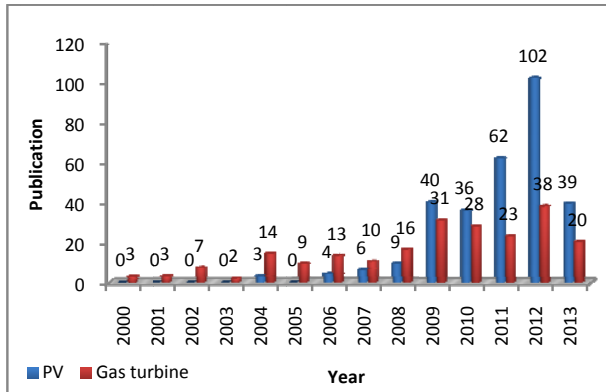


Fig. 2 The number of published papers on the DG types (source: web of knowledge October 2013)

### III. PROBLEM FORMULATION

Many researchers proposed several of techniques for loss minimization and allocation of DG due to improper placement and sizing for DGs which can cause the low or over voltage in the system. For loss minimization of DG, it is necessary to consider the reduction of  $I^2R$  loss. This is to ensure and improve the overall efficiency of power delivery in the distribution system. This parameter  $I^2R$  loss can be divided to active and reactive components of branch currents. The total  $I^2R$  loss in the distribution system with  $n$  number of branches is given in (1). The loss associated with the active and reactive power components of branch currents is given by (2) and (3).

$$P_{loss} = \sum_{j=1}^n I_j^2 R_j \quad (1)$$

$$P_{La} = \sum_{j=1}^n I_{aj}^2 R_j \quad (2)$$

$$P_{Lr} = \sum_{j=1}^n I_{rj}^2 R_j \quad (3)$$

where;

$I_j$  = current magnitude

$R_j$  = resistance at branch  $I$

$I_{aj}$  = active current component at branch  $I$

$I_{rj}$  = reactive current component at branch  $I$

There are two different types have been considered to show the effectiveness of the proposed method in the investigation of the DG installation problem. The installation of DG was reported as a method of minimizing the loss and could affect both the active and reactive power losses in the system [2]. In this study, the DGs are modeled as type I (PV) and type II (GT). The total real power loss and voltage profile for the base case of the system are calculated, where no DG is installed in the system. In order to study the impact of DG installation on the system, the following two cases are considered:

Case 1. The objective ( $f_i$ ) is to minimize loss while improve voltage profile in the presence of PV.

Case 2. The objective ( $f_i$ ) is to minimize loss while improve voltage profile in the present of GT.

Case 3. Comparing the system performance between the installation of PV and GT.

The objective function is proposed to minimize active power loss shown in (4).

$$f_1 = \text{Min} \left( \sum_{j=1}^n I_j^2 R_j \right) \quad (4)$$

In this study, IEEE 69-bus test system is used as the test specimen. In order to evaluate the effectiveness of the proposed technique, the test was conducted at various loading conditions ranging from 60% to 200% of the base load. The load variation was considered at all buses and also the total loading of the systems.

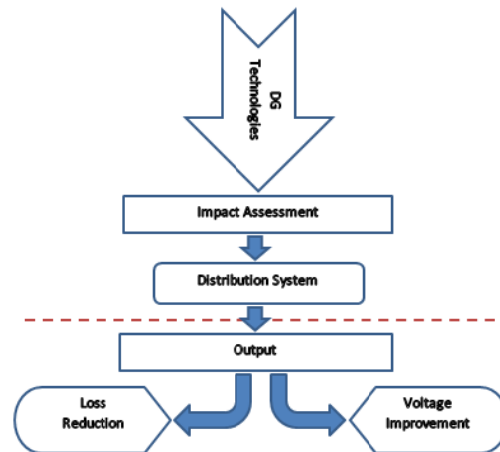


Fig. 3 Conceptual configuration for optimal sizing of different type of DG sources

**Step 1 Generate control variable**

Initialization process was conducted by generating the control variable using a uniformly distributed random number generation,  $X_i$ . The random numbers represent the value of  $x_i$  and  $\eta_i$  as the variable to be optimized.

**Step 2 Constraint violation test and fitness calculation**

Test the value of  $X_i$ . The evaluation of the fitness value ( $y_i$ ) of each population was calculated.

**Step 3 Mutation process**

A new population is formed by mutating the initial existing population using the mutation operator. Mutation is the only variation operator used for generating the offspring ( $x'_i, \eta'_i$ ) from the each parent. The fitness of the offspring was calculated using same objective function and represent as  $y'$ . The mutation formula for MEP is shown in (5) and (6)

$$\eta'_i(j) = \eta_i(j) \exp(\tau N(0,1) + \tau N_i(0,1)) \quad (5)$$

$$B'_i(j) = B_i(j) + \eta'_i(j) N_i(0,1) \quad (6)$$

**Step 4 Combine and sort population**

The offspring produced from the mutation process were combined with the parents to undergo the selection process using ranking scheme. The data was rank and sort based on the objective function set in equation (4).

**Step 5 Selection process for 'n' fireflies**

Based on the ranking data, the best 'n' population was selected as initial location of 'n' numbers of fireflies.

Table I tabulates the FA characteristic.

TABLE I  
FA CHARACTERISTIC

|  |      |
|--|------|
| Number of fireflies:                       | 20   |
| Maximum iteration:                         | 50   |
| Number of DG unit:                         | 1    |
| $\alpha$ (scaling parameter):              | 0.25 |
| Minimum value of $\beta$ (attractiveness): | 0.2  |
| $\gamma$ (absorption coefficient):         | 1    |

**Step 6 Calculate distance and attractiveness**

Move firefly  $i$  towards  $j$  in  $d$ -dimension. Attractiveness varies with distance  $r$  via  $\exp[-\gamma r]$ . Evaluate new solutions and update light intensity. The firefly attractiveness,  $\beta$  can be defined by (7). The distance between any two fireflies  $i$  and  $j$  are calculated using the Cartesian distance in (8). The movement of firefly  $i$  is attracted to another more attractive (brighter) firefly  $j$ , determined by (9).

$$\beta = \beta_0 e^{-\gamma r^2} \quad (7)$$

$$r_{ij} = \|x_i - x_j\| = \sqrt{\sum_{k=1}^d (x_{i,k} - x_{j,k})^2} \quad (8)$$

$$x_i = x_i + \beta_0 e^{-\gamma r^2} (x_j - x_i) + \alpha(\text{rand} - 0.5) \quad (9)$$

**Step 7 Fitness calculation**

The evaluation of the fitness value ( $y_i$ ) of each population was calculated.

**Step 8 Convergence test**

The convergence criterion is specified by the difference between the maximum and minimum fitness to be less than 0.0001. If the convergence condition is not satisfied, the processes will be repeated again until the convergence criterion is met.

$$\text{maximum fitness} - \text{minimum fitness} \leq 0.0001$$

The conceptual configuration designed for the effect of different DG type installation voltage monitoring scheme is shown in Fig. 3. In order to produce the best performance of DG installation in the system, the outputs of this study are loss reduction and voltage improvement.

## IV. METHODOLOGY

The EMEFA technique was developed with an objective to minimize the distribution losses while improving the voltage profile in the system. The EMEFA is developed based on embedded FA properties into the Meta Evolutionary Programming (MEP). Based on the literature study, it is found that hybridizing them together with other algorithms could improve the performance and become faster, efficient, and more robust [13]. The complete algorithm of the EMEFA is explained in the following procedural form in Fig. 4.

## V. RESULTS AND DISCUSSION

The proposed EMEFA technique was simulated and tested on the IEEE 69-bus test system. The effect of the DG installation using different types of DG is observed by installing the DG at bus 61. The idea is to minimize distribution losses with the proposed EMEFA. In the simulations, two conditions are addressed which are without DG and with DG installed in the system. The analysis was conducted based on two cases which are discussed below.

*A. Effect of DG Type in Loss Profile*

The effect of DG type in loss profile was tested and analyzed for case 1 and case 2 using EMEFA technique with the objective function is defined as in (4). The analysis was conducted by looking into variation in loading conditions at the load buses ranging from 60% to 200% of the base load condition. The results are discussed below.

**Case 1:**

In this case, the loss profile was calculated while optimal output of PV is determined with PV install at bus 61. The results are shown in Fig. 5. It is clear that the total power loss has been reduced with the PV installed in the system compared to without PV. Fig. 6 indicates the optimal PV output for loss minimization in the system for overall load increase in the system. The graph also shows that the PV output is higher as the loading increased from 60% to 200%.

**Case 2:**

Similar study was performed with GT install at bus 61. The results are shown in Fig. 7. It is clear that the total power loss has been reduced with the GT installed in the system compared to without GT.

Fig. 8 indicates the optimal GT output for loss minimization in the system for overall load increase in the system. The graph also shows that the GT output is higher as the loading increased from 60% to 200%.

Fig. 4 Complete algorithm of the EMEFA technique

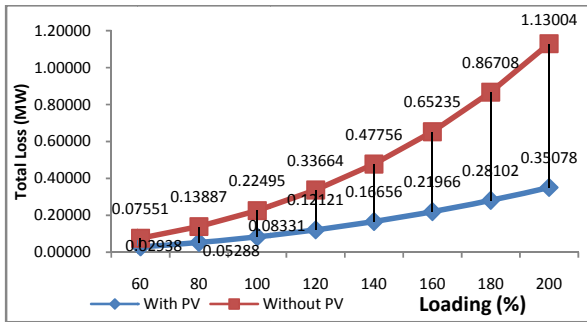


Fig. 5 Total losses with installation of PV for overall load increase in the system

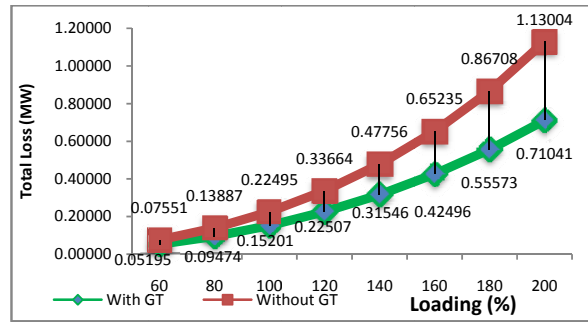


Fig. 7 Total losses with installation of GT for overall load increase in the system

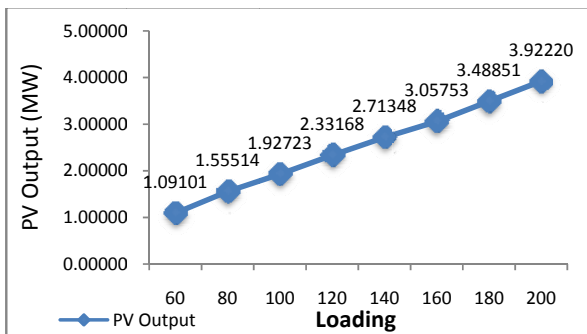


Fig. 6 Optimal PV output for loss minimization in the system for overall load increase in the system

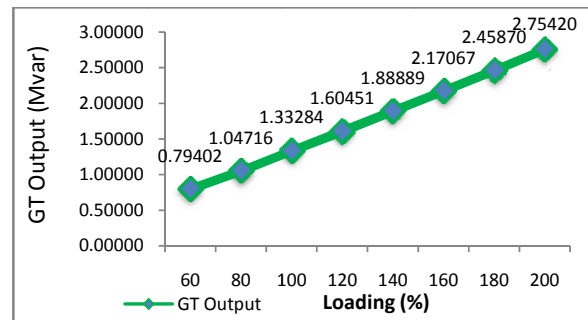


Fig. 8 Optimal GT output for loss minimization in the system for overall load increase in the system

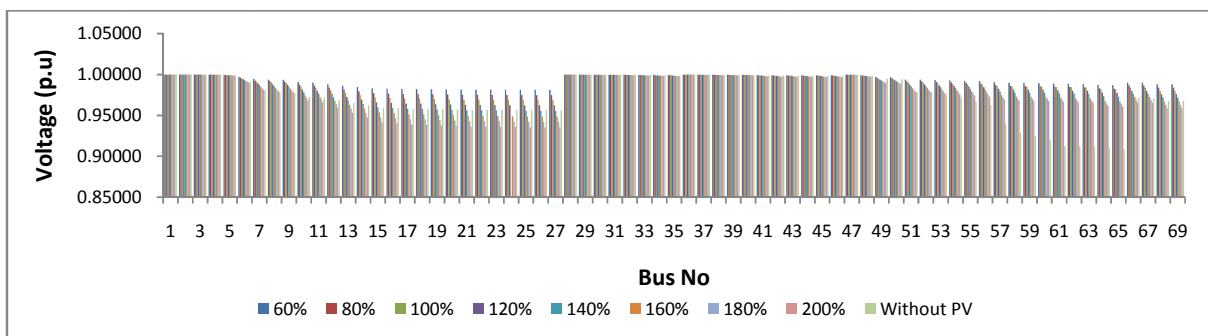


Fig. 9 Voltage performance with installation of PV for overall load increase in the system

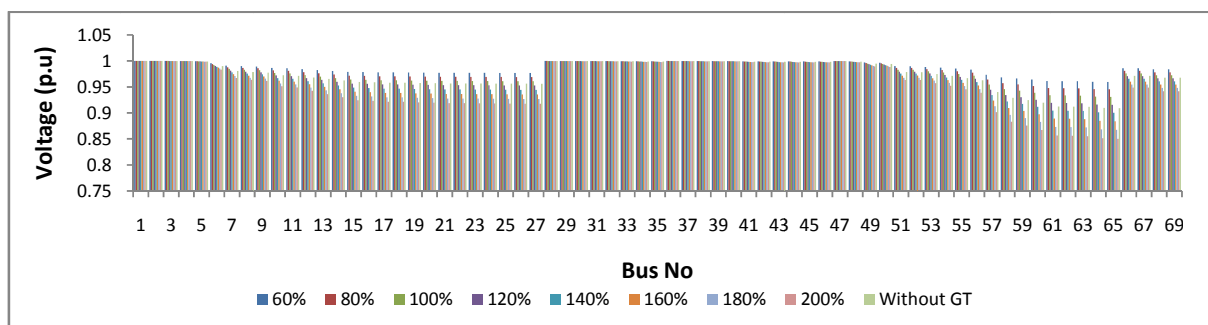


Fig. 10 Voltage performance with installation of GT for overall load increase in the system

### B. Effect of DG Type in Voltage Performance

The effect of DG type in voltage performance was tested and analyzed for case 1 and case 2. Fig. 9 indicates the voltage variation when the optimal PV install at bus 61 for overall load increase in the system. It could be observed that allocating PV at bus 61 has given better voltage improvement and the voltage profile of the system is maintained at an acceptable range compared to without DG. Similar study is conducted with GT installed at bus 61. Fig. 10 displayed the voltage variation when the optimal GT installed at bus 61. It can be observed that allocating GT at bus 61 has given better voltage improvement.

### C. Comparative Study on the System Performance between the Installation of PV and GT

The comparison in the system performance in terms of loss reduction between installation of PV and GT at bus 61 could be observed in the graphs shown in Fig 11. The results were compared to the base case to show the performance with the installation different types of DG in the system. From this graphs, it can be concluded that the installation of PV gives better loss minimization in the system as compared to GT. Fig 12 indicates the comparison on optimal PV and GT output for loss minimization and voltage improvement in the system for overall load increase in the system. The graph shows that the PV output is higher than GT output as the loading increased from 60% to 200%.

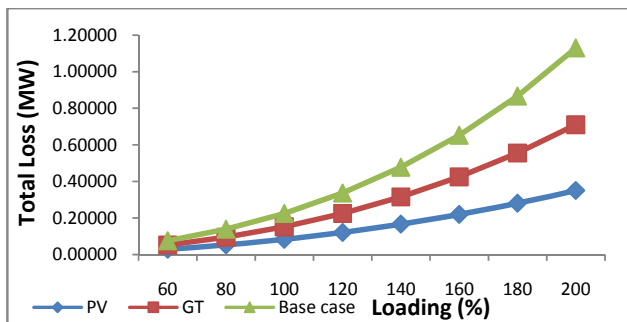


Fig. 11 Comparison on total losses for overall load increase in the system

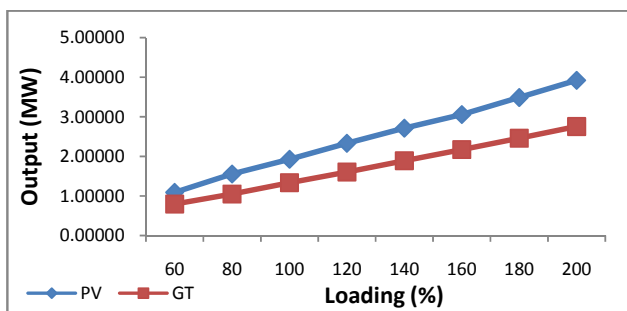


Fig. 12 Comparison on optimal output for PV and in the system for overall load increase in the system

## VI. CONCLUSION

In this paper, EMEFA approach for DG installation which considers the minimization of power loss and the voltage performance was successfully implemented and tested on IEEE 69 bus test system. This technique is developed to determine the optimal output of PV and GT with the load variation from 60% to 200% of the base load condition. The proper placement and sizing for DGs is very important to avoid the low or over voltage in the system. This is to ensure and improve the overall efficiency of power delivery in the distribution system. Comparative studies have been conducted in order to highlight its strength in terms of its ability to achieve optimal solution. It can be revealed that the proposed EMEFA has successfully reduced the loss profile and improving the voltage performance.

## ACKNOWLEDGMENT

The authors would like to acknowledge Research Management Institute (RMI) and Ministry of Higher Education for the financial supports of this research. This research is jointly supported by RMI and under the Fundamental Research Grant Scheme (FRGS) code of 600-RMI/ST/FRGS 5/3/FST (170/2010).

## REFERENCES

- [1] R. Passey, T. Spooner, I. MacGill, M. Watt, and K. Syngellakis, "The potential impacts of grid-connected distributed generation and how to address them: A review of technical and non-technical factors," *Energy Policy*, vol. 39, no. 10, pp. 6280–6290, Oct. 2011.
- [2] S. Segura, R. Romero, and M. J. Rider, "Efficient heuristic algorithm used for optimal capacitor placement in distribution systems," *Int. J. Electr. Power Energy Syst.*, vol. 32, no. 1, pp. 71–78, Jan. 2010.
- [3] V. K. Shrivastava, O. P. Rahi, V. K. Gupta, and S. K. Singh, "Optimal location of distribution generation source in power system network," *2012 IEEE Fifth Power India Conf.*, pp. 1–6, Dec. 2012.
- [4] M. Kotb and K. Sheb, "Genetic Algorithm for Optimum Siting and Sizing of Distributed Generation," *10th International Middle East Power Systems Conference (MEPCON)*, pp. 433–440, 2010.
- [5] M. Bavafa and N. Branch, "A new Method of Evolutionary Programming in DG Planning," *International Conference on Energy, Automation, and Signal (ICEAS)*, 2011, no. x.
- [6] A.M. El-Zonkoly, "Optimal placement of multi-distributed generation units including different load models using particle swarm optimization" *IET Generation, Transmission & Distribution*, vol. 5, no. March, pp. 760–771, 2011.
- [7] L.Y. Wong, S.R.A. Rahim, M. H. Sulaiman, O. Aliman, "Distributed generation installation using particle swarm optimization," *Power Engineering and Optimization Conference (PEOCO)*, June, pp. 159-163, 2010.
- [8] M. M. Wazir, A. Omar, and A. S. Rafidah, "Optimal allocation and sizing of distributed generation in distribution system via firefly algorithm," *Power Engineering and Optimization Conference (PEOCO)*, June, pp. 6–7, 2012.
- [9] G. Pepermans, J. Driesen, D. Haeseldonckx, R. Belmans, and W. D., "Distributed generation: definition, benefits and issues," vol. 33, pp. 787–798, 2005.
- [10] W. El-Khattam and M. M. Salama, "Distributed generation technologies, definitions and benefits," *Electr. Power Syst. Res.*, vol. 71, no. 2, pp. 119–128, Oct. 2004.
- [11] S. R. A. Rahim, I. Musirin, M. M. Othman, M. H. Hussain, M. H. Sulaiman, A. Azmi, "Effect of Population Size for DG Installation using EMEFA," *Power Engineering and Optimization Conference (PEOCO)*, June, pp. 746–751, 2013.
- [12] Q. Kang, T. Lan, Y. Yan, L. Wang, and Q. Wu, "Group search optimizer based optimal location and capacity of distributed generations," *Neurocomputing*, vol. 78, no. 1, pp. 55–63, 2012.

- [13] S. R. A. Rahim, I. Musirin, M. H. Hussain, and M. M. Othman, "EMEFA Approach for DG Installation in Distribution System," *Int. Rev. Model. Simulations*, vol. 5, no. 6, pp. 2546–2553, 2012.

**Siti Rafidah Binti Abdul Rahim** was born in Bota Kiri, Perak, in 1978. She received her Diploma in Electrical Engineering (Power) from Universiti Teknologi Malaysia (UTM) in 1999, Bachelor of Electrical Engineering (Hons) and Master in Electrical Engineering from Universiti Teknologi MARA in 2003 and 2006 respectively.

She is a lecturer at the School of Electrical System Engineering, Universiti Malaysia Perlis (UniMAP), Perlis, Malaysia. Her research interest includes AI application in power system, power quality and distributed generation (DG).

She is a member of IEEE Power and Energy Society, IACSIT and IAENG. Currently, she is a PhD candidate at Universiti Teknologi MARA.

**Assoc. Prof. Ismail Musirin** obtained Diploma of Electrical Power Engineering in 1987, Bachelor of Electrical Engineering (Hons) in 1990; both from Universiti Teknologi Malaysia, MSc in Pulsed Power Technology in 1992 from University of Strathclyde, United Kingdom and PhD in Electrical Engineering in 2005 from Universiti Teknologi MARA, Malaysia.

He is currently an Associate Professor at the Faculty of Electrical Engineering, Universiti Teknologi MARA, Shah Alam, Malaysia. His research interest includes power system stability, optimization techniques, distributed generator, biological computing, computational intelligence and artificial intelligence.

He is currently the Past Chair, IEEE PES Malaysia Chapter, member of Computational Intelligence-IEEE, Senior Member of IACSIT, member of IAENG and ARTIST.

**Assoc. Prof. Dr. Muhammad Murtadha Othman** received Bachelor of Electrical Engineering (Hons) in 1998 from The Staffordshire University, UK, MSc in Electrical Engineering in 2000 from Universiti Putra Malaysia and PhD in Electrical Engineering in 2006 from Universiti Kebangsaan Malaysia.

He is currently a Associate Professor at The Faculty of Electrical Engineering, Universiti Teknologi MARA, Shah Alam, Selangor, Malaysia. His research interest includes power system optimization, artificial intelligence application in power system, biological computing techniques, voltage stability studies, available transfer capability and power system reliability

**Muhamad Hatta Hussain** was born in Sungai Petani, Kedah in 1976. He obtained Diploma in Electrical Engineering (Electronic) in 1998 from Institut Teknologi MARA (ITM). He received Bachelor of Engineering (Electrical) (Hons) from Universiti Teknologi MARA (UiTM) in 2000.

He was appointed as Cable Design Engineer (Power Cable & Telephone Cable) at Leader Cable Industry Berhad (LCIB) starting from 2000 until 2003. He obtained a Master in Electrical Engineering (Electronics & Telecommunications) in 2009 from Universiti Teknologi Malaysia (UTM). He is a lecturer at the School of Electrical System Engineering, Universiti Malaysia Perlis (UniMAP), Perlis, Malaysia. His research interest includes AI application in power system protection and communications.

He is a member of IEEE, member of BEM and member of IAENG. Currently, he is a PhD candidate at Universiti Teknologi MARA (UiTM).